


RISER QUADRANT
SPECIFIED BY P.G.E.

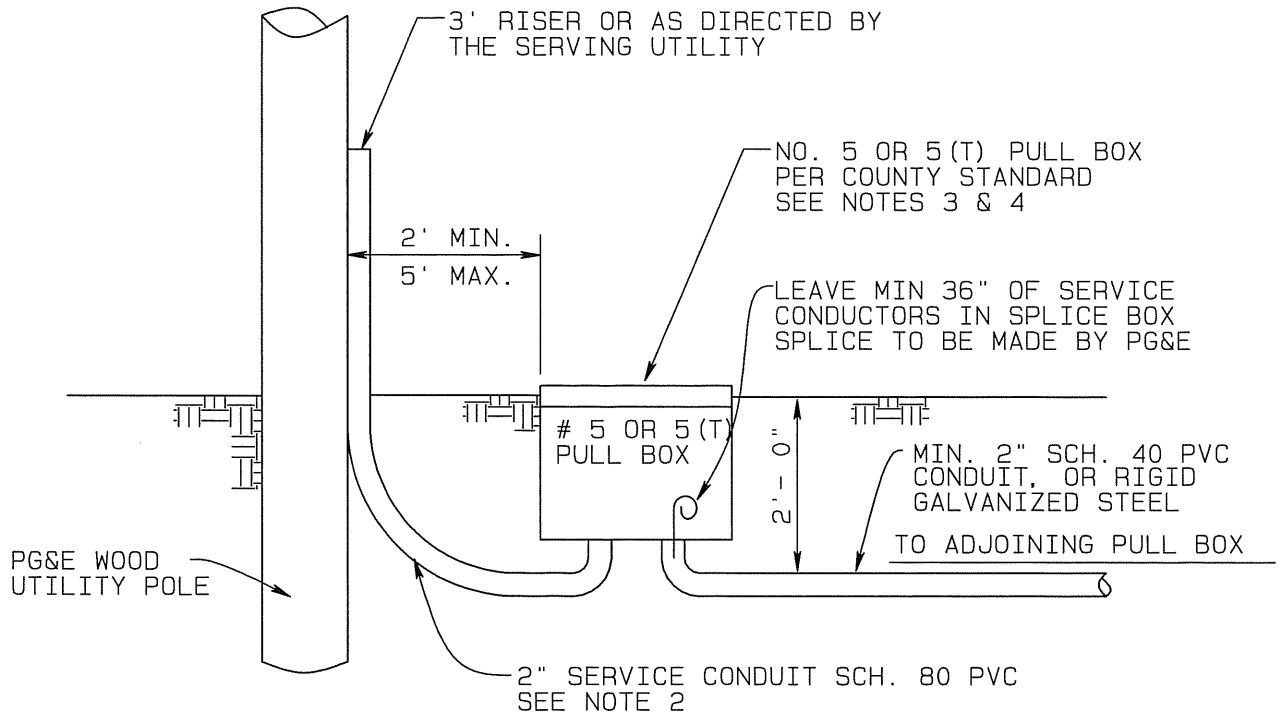

OVERHEAD SERVICE

NOTES:

1. CONSTRUCTION SHALL CONFORM TO THESE REQUIREMENTS EXCEPT AS OTHERWISE DIRECTED BY THE COUNTY ENGINEER.
2. CONTRACTOR SHALL INSTALL #5 OR 5(T) PULL BOX, 2" SERVICE CONDUIT, AND 2" CONDUIT AND CONDUCTORS FROM EQUIPMENT TO PULL BOX.
3. CONDUIT AND CONDUCTOR TO ENTER PULL BOX THROUGH BOTTOM OF BOX. PULL BOXES SHALL BE PARALLEL WITH THE ROADWAY.
4. SEE COUNTY DRAWING NO. 600, NOTE NO. 3 TO DETERMINE IF A #5 OR 5(T) PULL BOX IS REQUIRED. ALSO CHECK PLANS AND NOTES.

COUNTY OF SONOMA DEPARTMENT OF TRANSPORTATION AND PUBLIC WORKS		
ELECTRIC SERVICE DETAIL OVERHEAD SERVICE		
DATE: MAY 2004	REVISED:	
APPROVED BY:	SCALE: NONE	DRAWING NO. 608